
-TYPICAL ARRANGEMENT OF DUCT ENTRANCES.

DUCTS MAY ENTER THE PULL BOX AT ANY ANGLE

OR LOCATION AT THE SPECIFIED DEPTH AND

SHOULD BE APPROXIMATELY 150 mm ABOVE THE FLOOR

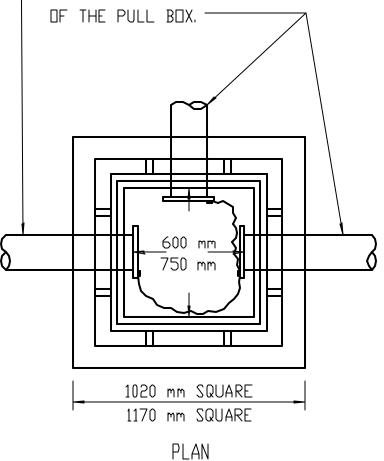

<u>NOTE</u>

THE BUSHING SHALL BE INSULATED AND HAVE A GROUND LUG FOR #6 COPPER WIRE, ALL CONDUITS SHALL BE WIRED/GROUNDED TOGETHER WITH THE BARE #6 COPPER WIRE.

PULL BOX PLAN NOT TO SCALE

7/14/00

REVISED